TRENCH SECTION CUT DETAIL

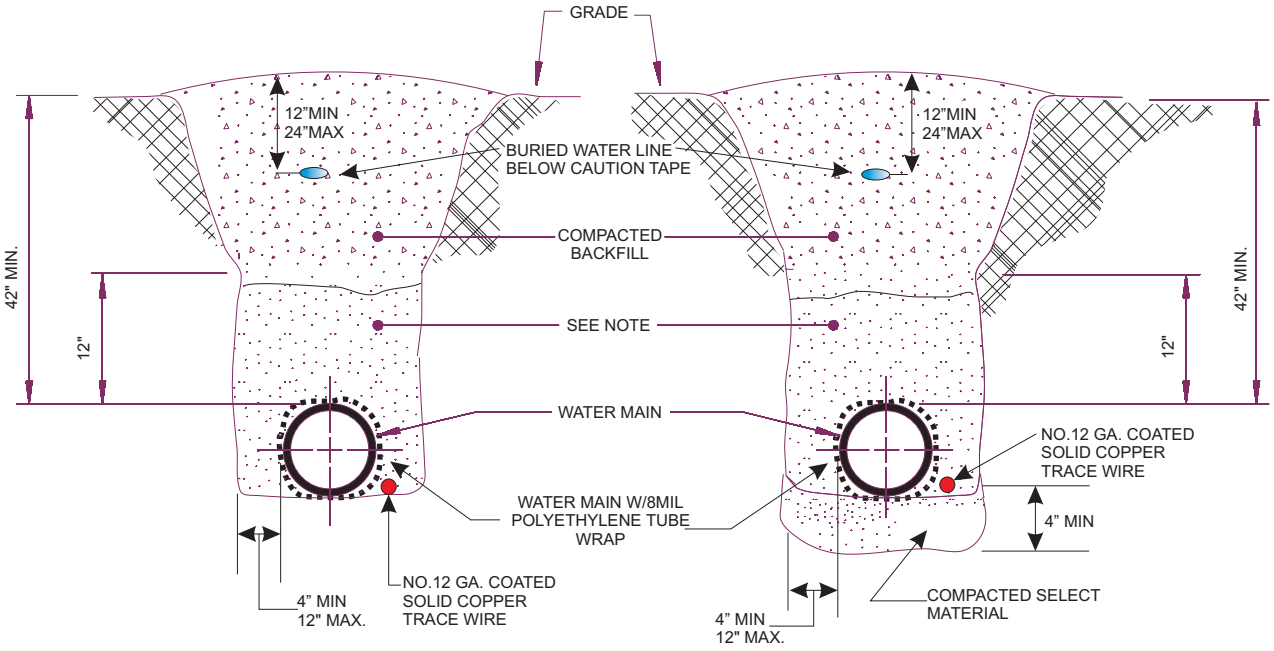

TRENCH SECTION IN SOIL

TRENCH SECTION IN ROCK

NOTE: COMPACTED BACKFILL SHALL BE PLACED TO A ONE FOOT MIN. DEPTH OF COVER. THE INITIAL BACKFILL SHALL BE A MATERIAL FREE FROM ROCKS GREATER THAN 1/2 " DIA., SOIL CLODS, OR FROZEN MATERIAL. IF AUTOMATIC TAMPERS ARE USED, CARE SHALL BE EXERCISED TO AVOID DAMAGE TO THE PIPE.

O.S.H.A TRENCH DETAIL

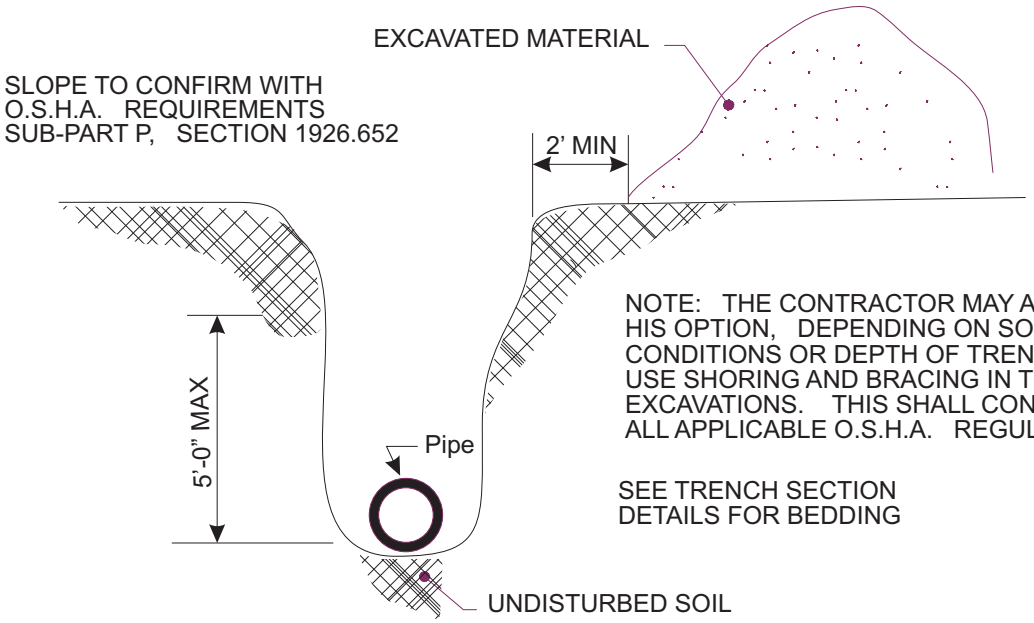

NOTE: THE CONTRACTOR MAY AT HIS OPTION, DEPENDING ON SOIL CONDITIONS OR DEPTH OF TRENCH, USE SHORING AND BRACING IN TRENCH EXCAVATIONS. THIS SHALL CONFORM TO ALL APPLICABLE O.S.H.A. REGULATIONS.

SEE TRENCH SECTION DETAILS FOR BEDDING

PADUCAH WATER STANDARD SPEC DRAWING NO. PW-08
TYPICAL TRENCH SECTION DETAIL

Paducah Water