



**SECTION VIEW**

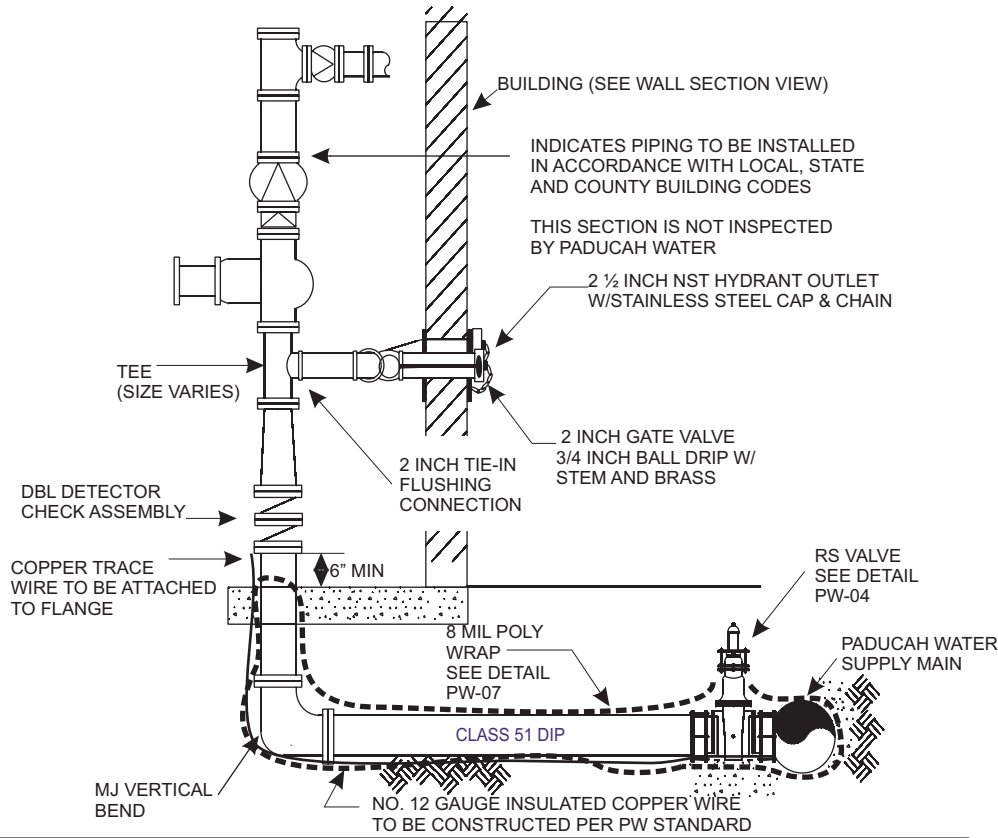

**GENERAL CONSTRUCTION NOTES:**

- 1) ALL UNDERGROUND PIPE MATERIAL SHALL BE CLASS 51 DIP.
- 2) THE UNDERGROUND PIPE INSTALLATION AND TESTING SHALL ADHERE TO PADUCAH WATER STANDARD SPECIFICATIONS. SEE SECTION 30 PAGE 14 & 15.
- 3) PROPERTY OWNER SHALL BE RESPONSIBLE FOR MAINTENANCE AND OPERATION OF THE BACKFLOW ASSEMBLY AND COMPLIANCE WITH REPORTING AND TESTING REQUIREMENTS AS REQUIRED BY STATE AND LOCAL ENFORCEMENT AGENCIES.
- 4) PROPERTY OWNER SHALL BE RESPONSIBLE FOR THE MAINTENANCE OF THE UNDERGROUND PIPING FROM THE SUPPLY MAIN UP TO AND WITHIN THE BUILDING.
- 5) PADUCAH WATER WILL OPERATE THE MAIN CUT OFF VALVE AT THE SUPPLY MAIN UNLESS OTHERWISE APPROVED.
- 6) PADUCAH WATER WILL REQUIRE A FLUSHING POINT CONSTRUCTED WITHIN THE FIRE SPRINKLER SYSTEM, SEE STANDARD DRAWING NO. PW-13.
- 7) PADUCAH WATER WILL REQUIRE AT A MINIMUM THE INSTALLATION OF A DOUBLE CHECK DETECTOR BACKFLOW PREVENTION VALVE ASSEMBLY FOR ALL NON-HAZARDOUS DEVELOPMENTS. THE DCDA SHALL COMPLY WITH ALL LOCAL AND STATE CODES.
- 8) PADUCAH WATER WILL REQUIRE THE INSTALLATION OF A REDUCED PRESSURE DETECTOR ASSEMBLY FOR ALL TOXIC AND/OR HIGH HAZARD TYPE DEVELOPMENTS AND SHALL COMPLY WITH ALL LOCAL AND STATE CODES.

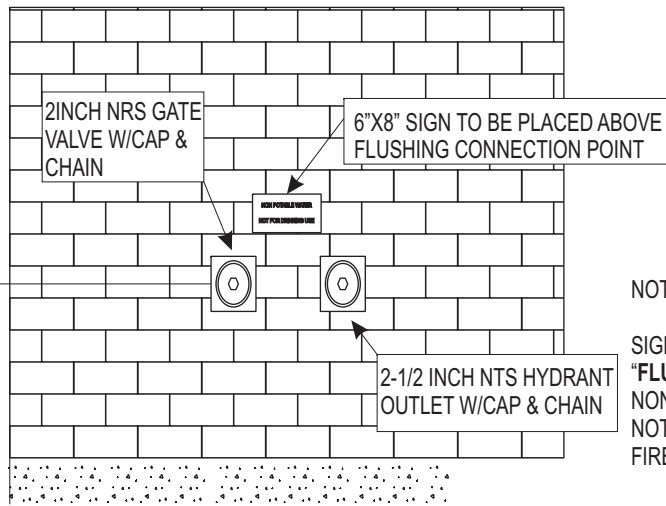

**NOTE:**

SIGN TO READ  
**"FLUSHING DEVICE ONLY"**  
 NON POTABLE WATER  
 NOT FOR DRINKING OR  
 FIRE DEPT CONNECTION

**WALL SECTION VIEW**