


**MOBILE HOME PARK
ACCESS ROAD**

**PADUCAH WATER STANDARD SPEC DRAWING NO. PW-16.A
MOBILE HOME PARK ALTERNATE "B" DETAIL**

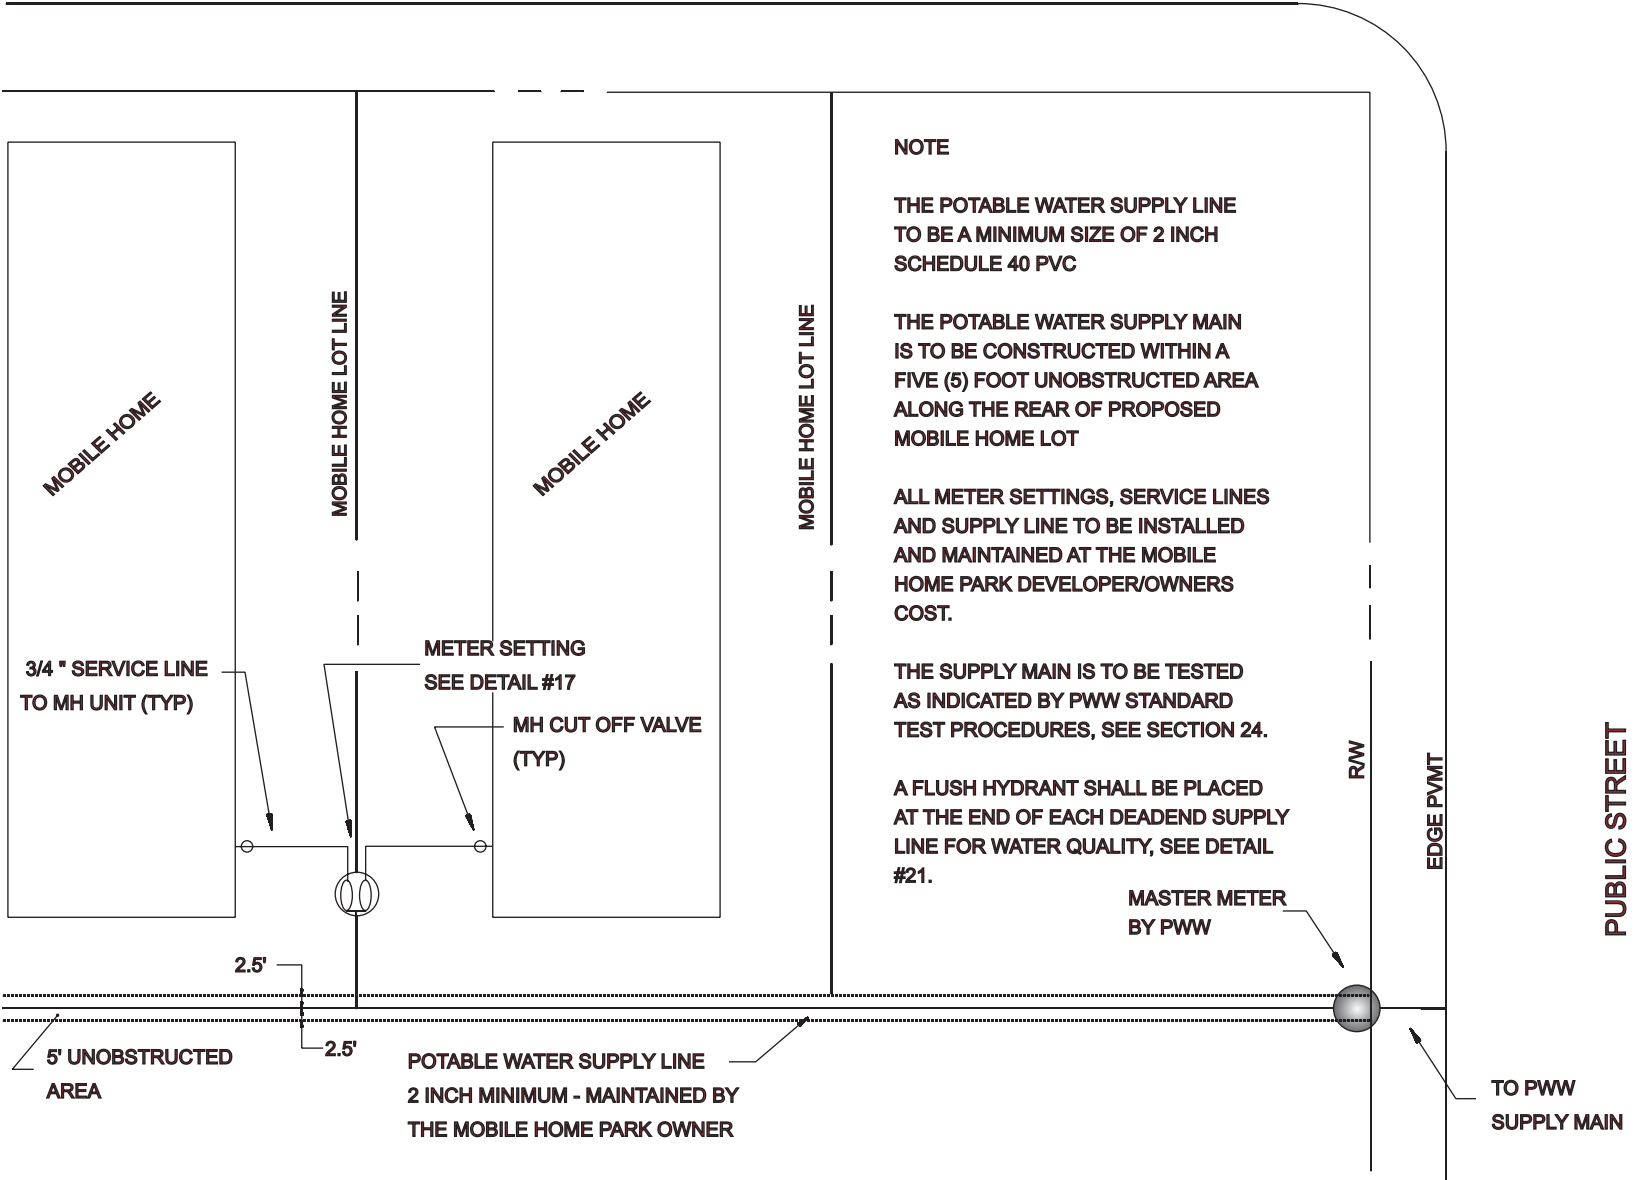

NOTE

THE POTABLE WATER SUPPLY LINE TO BE A MINIMUM SIZE OF 2 INCH SCHEDULE 40 PVC

THE POTABLE WATER SUPPLY MAIN IS TO BE CONSTRUCTED WITHIN A FIVE (5) FOOT UNOBSTRUCTED AREA ALONG THE REAR OF PROPOSED MOBILE HOME LOT

ALL METER SETTINGS, SERVICE LINES AND SUPPLY LINE TO BE INSTALLED AND MAINTAINED AT THE MOBILE HOME PARK DEVELOPER/OWNERS COST.

THE SUPPLY MAIN IS TO BE TESTED AS INDICATED BY PWW STANDARD TEST PROCEDURES, SEE SECTION 24.

A FLUSH HYDRANT SHALL BE PLACED AT THE END OF EACH DEADEND SUPPLY LINE FOR WATER QUALITY, SEE DETAIL #21.

MASTER METER BY PWW

TO PWW SUPPLY MAIN