



**PADUCAH WATER STANDARD SPEC DRAWING NO. PW-22" A"
COMMERCIAL AND RETAIL CENTER MULTI-UNIT METER DETAIL**

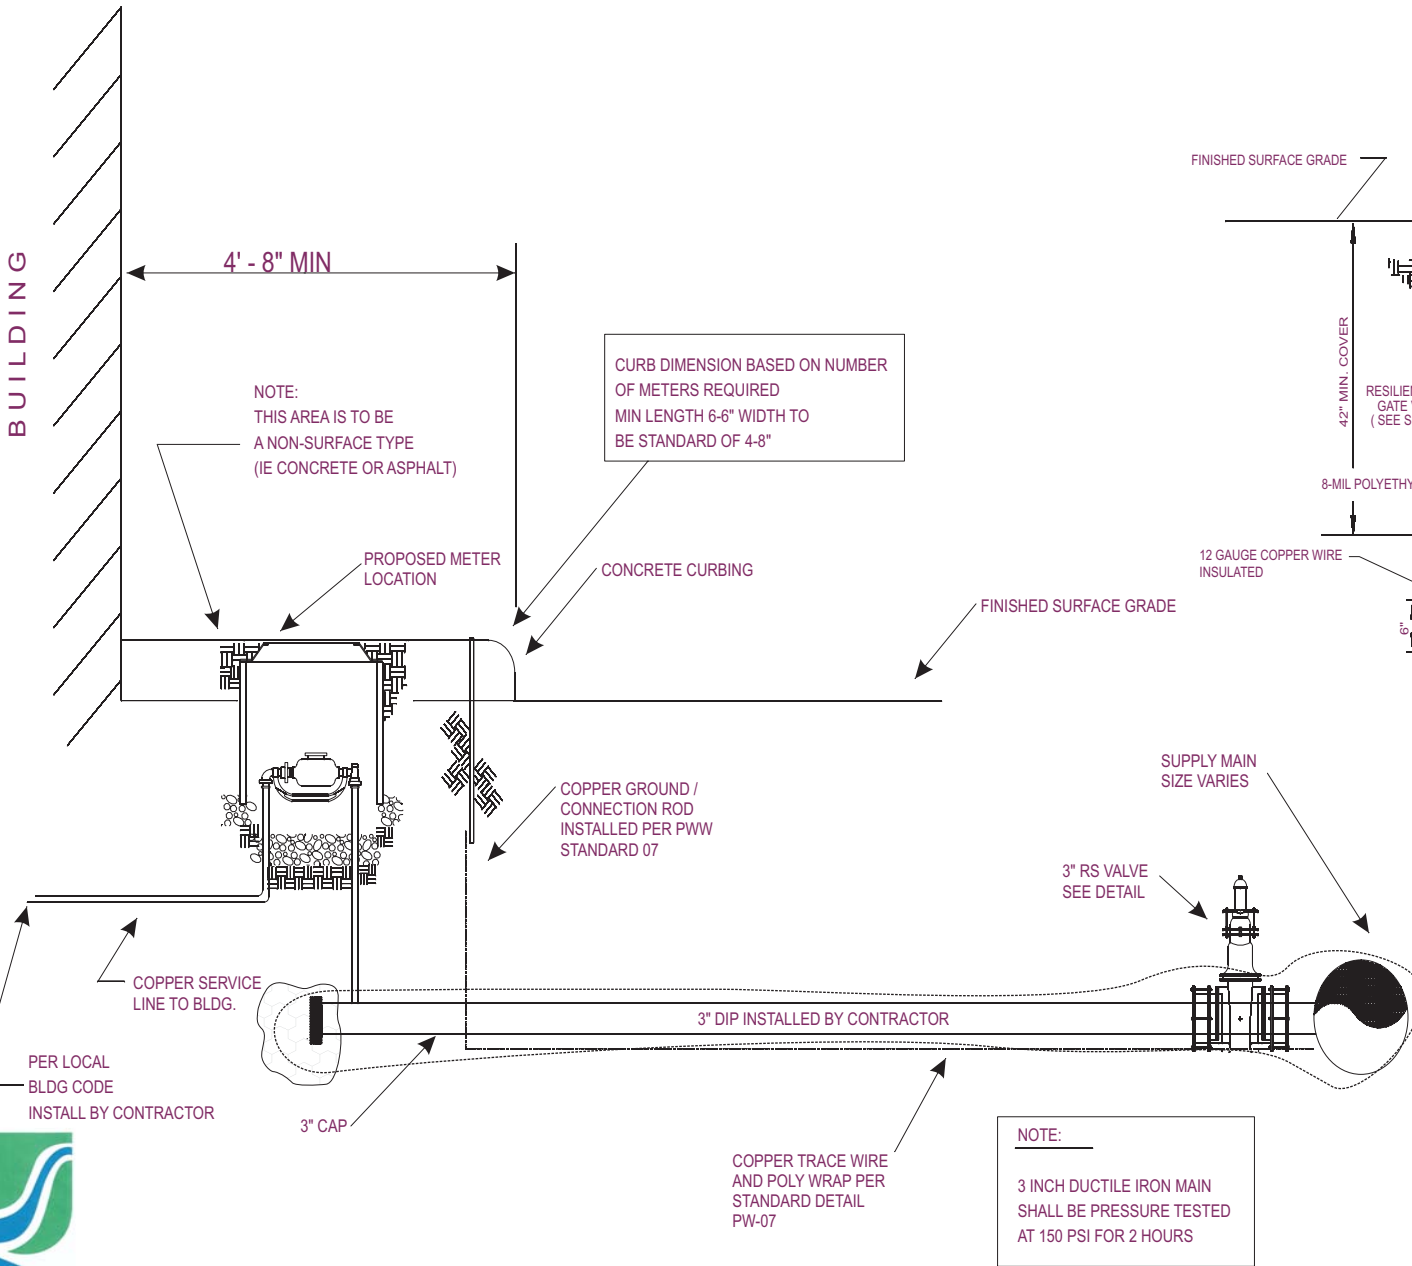

CURB DIMENSION BASED ON NUMBER OF METERS REQUIRED
MIN LENGTH 6-6" WIDTH TO BE STANDARD OF 4-8"

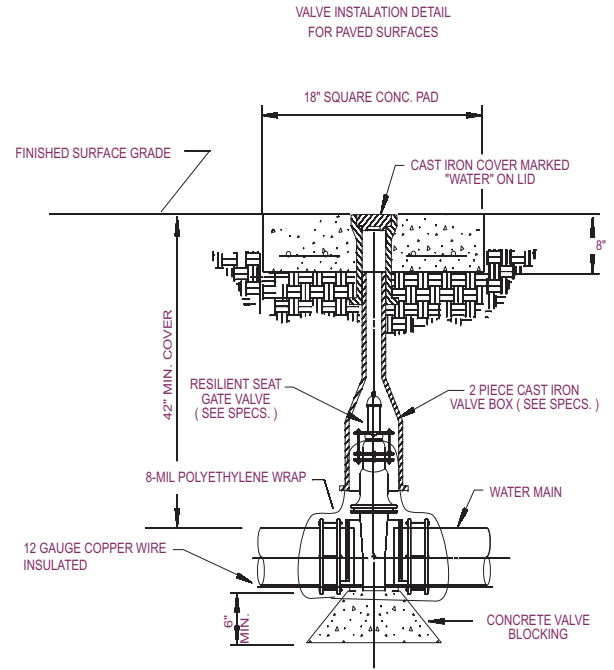

VALVE INSTALLATION DETAIL SEE PW04

NOTE:
3 INCH DUCTILE IRON MAIN SHALL BE PRESSURE TESTED AT 150 PSI FOR 2 HOURS



22A